


1

BUCHHOLZ RELAY
BUCHHOLZRELAIS

ALARM / ALARME
TRIP / AUSLOESUNG




Cables 1,5 mm²
Kabel 1,5 mm²

2

OIL THERMOMETER
ZEIGERTHERMOMETER

ALARM / ALARME
TRIP / AUSLOESUNG




Cables 1,5 mm²
Kabel 1,5 mm²


3

OIL LEVEL INDICATOR
OELSTANDANZEIGER


MINIMUM LEVEL
MIN. STAND



Cables 1,5 mm²
Kabel 1,5 mm²

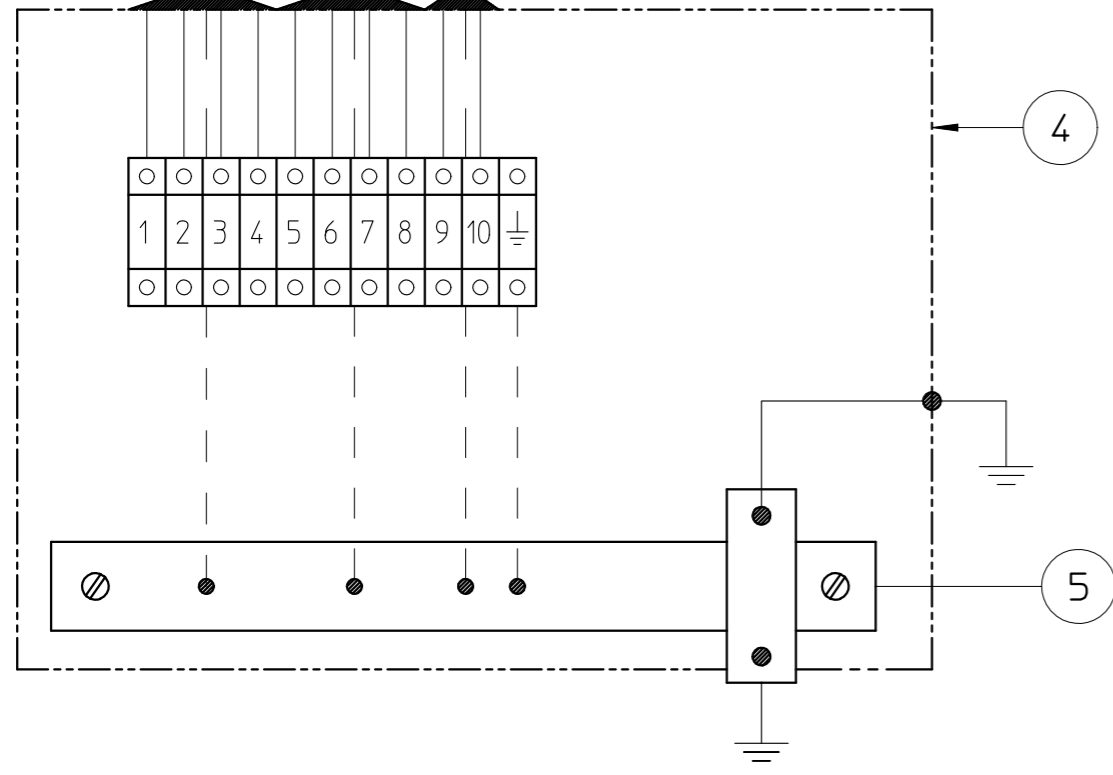

5	EARTHING BAR ERDUNGSSCHIENE	Cu 10x3mm ²	1
4	AUXILIARY TERMINAL BOX SCHALTKASTEN		1
3	OIL LEVEL INDICATOR OELSTANDANZEIGER	9 - 10	1
2	OIL THERMOMETER ZEIGERTHERMOMETER	5 - 6 7 - 8	1
1	BUCHHOLZ RELAY BUCHHOLZRELAIS	1 - 2 3 - 4	1
POS	LEGEND BENNENUNG	TERM.	N°



OCREV
CASTELGOMBERTO (VICENZA)
ITALY

KUNDE **PRESSCONTROL**

TECHN. DATEN

SCHALTBILD

N° 1 OELTRAFO 3 PHASEN Typ TOE

6000 kVA - 30±2x3,33%-20±2x5% / 15 kV - 50 Hz - Dyn5

Trafo nummer 66581

AUFTRAG
N° AF08.20.065.001

COMM.
N° 247.08

ZEICHNUNG NR.
TL 1405SC

⊕	SCALE / : /	DATUM	GEZ.	KONTROLLE	GEPR.
		02/09/2008	AM	AM	FZ

AENDERUNG	0	Ausgegeben
	1	
	2	
	3	